

Series 3000SS-NZ

Double Check Detector Assembly

Size: DN65-DN250

The series 3000SS Double Check Detector Assemblies are designed to prevent the reverse flow of polluted water from entering the potable water supply. These models can be applied, where approved by the local authority, for cross connection control in Medium and Low Hazard installations. Series 3000SS feature short end-to-end dimensions, light weight stainless steel body, and low head loss.

Features


- Cam-Check Assembly valve provides low head loss
- Short lay length is ideally suited for retrofit installations
- Stainless Steel body is half the weight of competitive designs reducing installation and shipping cost
- Stainless steel construction provides long term corrosion protection and maximum strength
- Single top access cover with two-bolt grooved style coupling for ease of maintenance
- No special tools required for servicing
- Compact construction allows for smaller vaults and enclosures
- Furnished with 20mm bypass line
- Bypass with removable spool to allow fitting of approved Water meter

Material


Component	Material
Internal Metal Parts	Stainless Steel
Valve Body	Stainless Steel
Check Assembly	Norly®

Norly® is a registered trademark of General Electric Company.

Installation Dimensions

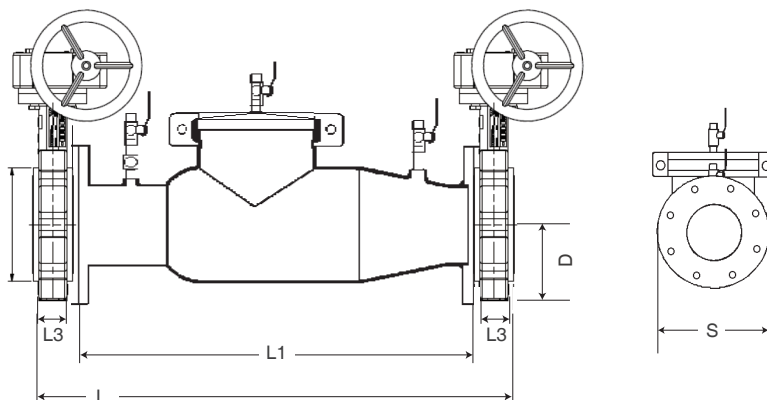

Size	Dimensions					Net Weigh for Device Only kg.
	L	L1	L3	D	S	
mm	mm	mm	mm	mm	mm	
65	651	559	46	89	178	31
80	651	559	46	95	178	32
100	663	559	52	114	229	33
150	811	699	56	140	279	54
200	871	749	61	171	343	82
250	885	749	68	200	406	86

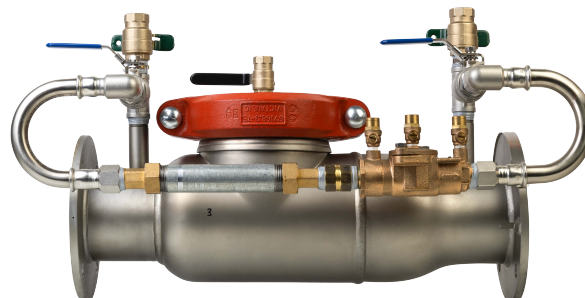

Specification

- Device: AS/NZS 2845.1, ASSE 1048, AWWA C510-92, CSA B64.5, UL 1469
- Connections: AS2129 Table E

Pressure-Temperature

- Temperature Range: 0.5°C – 43°C
- Maximum Working Pressure: PN12 (1200kPa)

Approvals

UL Classified (OSY only), FM (sizes 21/2" – 10", OSY only)
USC Foundation for Cross-Connection Control and Hydraulic Research










For 12" assembly approvals consult factory.

Characteristic Curves

Flow curves as tested by Underwriters Laboratory per UL 1469,1996.

* Rated flow

**UL Tested flow

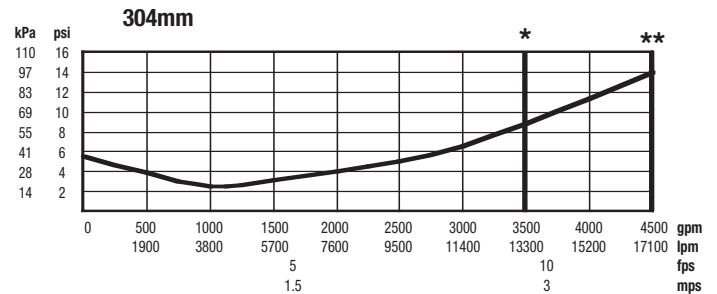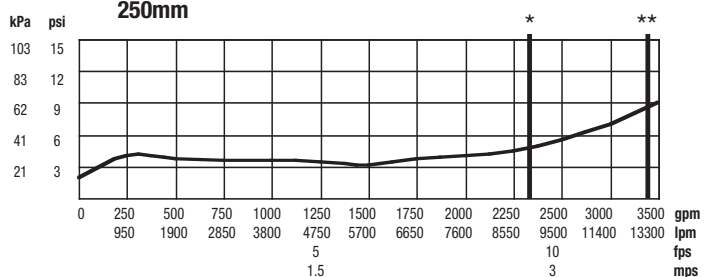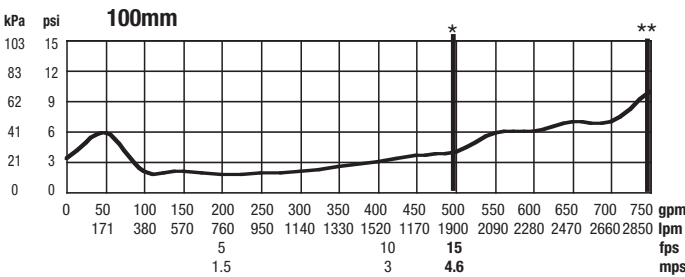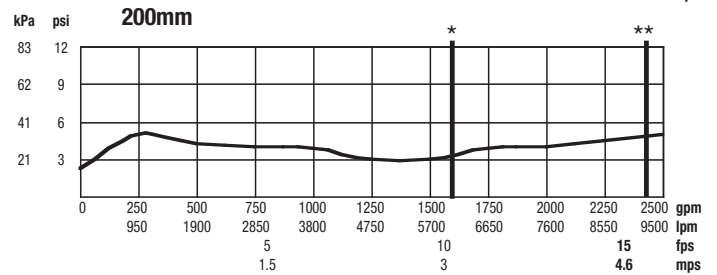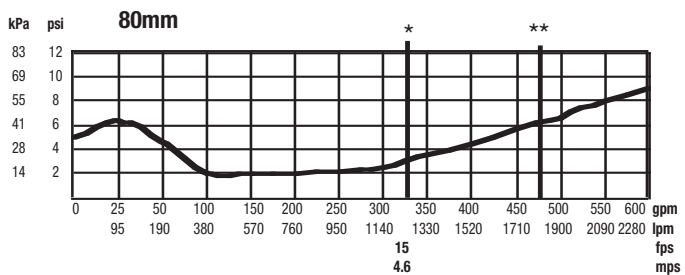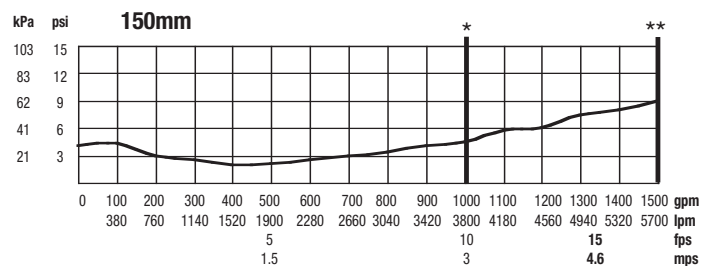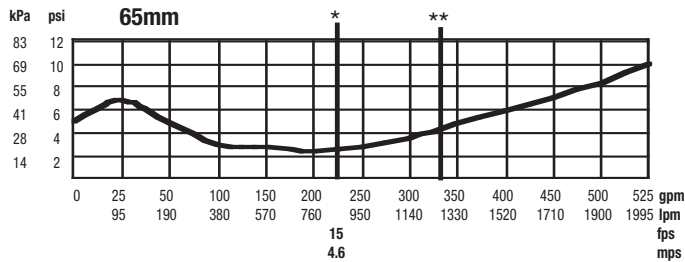

Typical Installation

Model 3000SS-NZ Double Check Detector Assembly should be installed with adequate clearance and easy accessibility for testing and maintenance and must be protected from freezing. Local codes shall govern installation requirements.

Fittings such as end connectors intended to join alternative pipe systems made from other materials (e.g. plastics) shall also conform to the relevant dimensional and performance requirements of the appropriate Australian, New Zealand, or joint Australian/New Zealand Standard for the alternative pipe system.

Test the assembly at initial installation, after servicing or maintenance to AS/NZS2845.3 and local regulatory authority requirements.